


HUTCHINSON UTILITIES COMMISSION

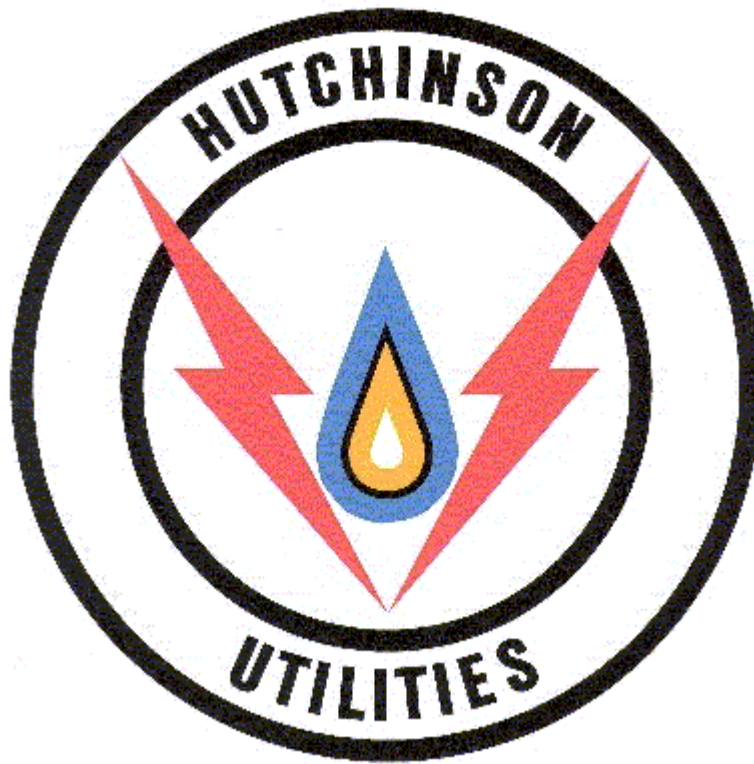

TRANSMISSION INTERCONNECTION GUIDELINES

MAY 2013

I. INTRODUCTION

A. OBJECTIVES

The purpose of this handbook is to provide technical guidelines to assist the Applicant desiring to interconnect with the Hutchinson Utilities Commission (HUC) electric transmission system (“HUC System”) in establishing the interconnection in an efficient and consistent manner to meet the minimum requirements for safe and reliable operation of the interconnection. This document is designed to comply with the North American Electric Reliability Corporation’s (NERC) compliance directive to establish facility connection standards.

These guidelines are not intended to be a design specification or instruction manual but to provide the technical guidance needed to achieve the following:

- Ensure the safety of the general public and HUC personnel.
- Avoid degradation to the reliability and service of all users of the HUC System.
- Minimize the possible damage to the property of the general public, HUC Customers, and HUC.
- Minimize adverse operating conditions on the HUC System.
- Permit the Applicant to operate with the HUC System in a safe, reliable and efficient manner.
- Accurately measure and account for all injections and extractions from the interconnected system.

B. APPLICABILITY

This document governs the interconnection of transmission to transmission tie-lines or transmission-connected, load serving substation. It does not cover interconnection of generators to transmission or connection to distribution facilities. Generation interconnection requirements are described in the “Generation Interconnection Guidelines” document.

HUC’s transmission facilities are heavily integrated with those of other utilities. The requirements listed here may need to be modified on a case-by-case basis if the interconnection impacts facilities owned by other utilities.

C. CONTACT INFORMATION

New Interconnection Applicants

For new interconnections or modifications to existing facilities please contact:

Manager, Transmission Strategy & Business Planning
Great River Energy
12300 Elm Creek Boulevard
Maple Grove, MN 55369-4718
(763) 445-5000

Normal and Emergency Operations

In the event of an emergency or for normal operations contact:

Great River Energy Operations Control Center
(763) 241-2340

Hutchinson Utilities Commission System Control
(320) 587-4745

II. GENERAL POLICY AND REQUIREMENTS

A. COMPLIANCE WITH INTERCONNECTION REQUIREMENTS

The requirements set forth by this document are intended to comply with the FERC's final rules on Open Access (FERC Orders 888, 889), all state and federal regulatory agency requirements and other applicable requirements of other entities related to owners and operators of electric systems and associated interconnected facilities such as NERC, MISO, Applicable Reliability Corporation, or any successor agency assuming or charged with similar responsibilities related to the operation and reliability of the North American electric interconnected transmission grid. While these requirements comply with today's industry standards, the electric industry is undergoing a major restructuring and changes can be expected. The applicant needs to work closely with HUC to keep up to date on the interconnection requirements.

It is the responsibility of the Applicant to obtain all permits and approvals of the governing bodies and to comply with all applicable electrical and safety codes.

The Applicant is responsible for ensuring that the interconnection complies with all NERC, MISO, Applicable Regional Entity, Rural Utilities Service and other applicable industry planning, design, and operating standards – including any periodic testing that may be required.

B. RESPONSIBILITY AND APPROVAL

HUC does not assume responsibility for protection of the Applicant's interconnected equipment or of any other Applicant equipment. The Applicant is solely responsible for protecting its equipment to prevent damage from faults, imbalances, or other disturbances on the HUC System. HUC will not be responsible for damage to the Applicant's equipment due to out-of-phase reclosing. Such an event will likely cause damage to the Applicant's equipment and must be carefully addressed.

Technical aspects addressing protection requirements are expanded in Section VI.

Approval of the proposed interconnection only ensures that HUC has reviewed the interconnection to make certain that the HUC System can be maintained and that other HUC customers are not adversely affected by operation of the interconnecting facilities. HUC will not assume any liability or responsibility for Applicant-owned equipment.

C. FINANCIAL OBLIGATION ASSOCIATED WITH INTERCONNECTION TO THE HUC SYSTEM

Through appropriate agreement(s), HUC may make provisions to recover costs. The following expense categories are examples of (but not all-inclusive of) items reimbursable to HUC:

- Meter installation, tests, maintenance, parts and related labor
- Meter reading and scheduling
- Telemetry installation, tests, maintenance, parts and related labor
- Operating expenses, including telecommunication circuits
- Study analysis and related expenses
- Securing regional reliability organization or equivalent acceptance
- Modifications to the HUC System and related labor/engineering
- Protective device installation/equipment cost and related labor
- Protective device settings review and coordination.
- Review of design, inspection and testing costs
- Programming costs to incorporate generation and tie-line data into HUC's energy management system
- Land, rights-of-way, licensing, engineering, etc.

D. FINANCIAL PENALTIES

If operation of the Applicant's Facility causes HUC to be out of compliance with any applicable rules, regulations, and/or requirements of NERC, MISO, Applicable Regional Entity, or any successor agency assuming or charged with similar responsibilities related to the operation and reliability of the North American electric interconnected transmission grid, and if HUC is assessed a penalty, fee, or charge for such non-compliance, said penalty will be passed through to the Applicant.

E. REQUESTS FOR TRANSMISSION SERVICE

The ability to interconnect to the HUC system does not mean the Applicant can deliver power over HUC's facilities at all times and to any location. This determination is made under the HUC or Regional Transmission Organization tariff through the reservation of transmission service.

III. COMMON INTERCONNECTION REQUIREMENTS AND RESPONSIBILITIES

A. SAFETY AND ISOLATING DEVICES

At the Point of Interconnection to the HUC System, an isolating device, which is typically a disconnect switch, shall be provided that physically and visibly isolates the HUC System from the Applicant's Facilities. All switchgear that could energize equipment shall be visibly identified (tagged), so that all maintenance crews can be made aware of the potential hazards. Such devices shall:

- Simultaneously open all phases (gang-operated) to the connected facilities.
- Be accessible by HUC and may be under HUC System Operator jurisdiction.
- Be lockable in the open position by HUC.
- Not be operated without advance notice to either party, unless an emergency conditions requires that the device be opened to isolate the interconnected facilities.
- Be suitable for safe operation under the conditions of use.

HUC personnel may lock the device in the open position and install safety grounds if:

- It is necessary for the protection of maintenance personnel when working on deenergized circuits.
- The interconnected Facility or HUC equipment presents a hazardous condition.
- The interconnected Facility interferes with the operation of the HUC System.
- The HUC System interferes with the operation of the interconnected Facility.

B. CONTROL AND PROTECTION

HUC plans its protective relays and control schemes to provide for personnel safety and equipment protection and to minimize disruption of services during disturbances. Interconnections onto the HUC System usually require additions or modifications of HUC's protective relays and/or control schemes. New Interconnections must be compatible with HUC's existing protective relay schemes. Sometimes the additions of voltage transformers (VTs), current transformers (CTs), or pilot schemes (transfer trip) are necessary, based on the Point of Interconnection. Exact protective requirements are outlined in Section VI.

C. DISPATCHING AND MAINTENANCE

HUC operates and maintains its system to provide reliable customer service while meeting the seasonal and daily peak loads even during equipment outages and disturbances. Project integration requires that the equipment at the Point of Interconnection not restrict timely outage coordination, automatic switching or equipment maintenance scheduling. Preserving reliable service to all HUC customers is essential and may require additional switchgear, equipment redundancy, or bypass capabilities at the Point of Interconnection for acceptable operation of the system.

D. REMEDIAL ACTION SCHEME

The HUC System has been developed with careful consideration for system stability and reliability during disturbances. The type of connection, size of the load, breaker configurations, load characteristics, and the ability to set protective relays will affect where and how the Point of Interconnection is made. The Applicant may be required to participate in special protection schemes, called remedial action schemes (RAS) such as load shedding or load tripping. The portion of the transmission path capacity that the Applicant uses determines the pro rata share of RAS. If RAS participation is required, the Applicant and HUC will jointly plan and coordinate the RAS implementation.

E. STATION SERVICE

Power that is provided for local use at a substation to operate lighting, heat and auxiliary equipment is termed station service. Alternate station service is a backup source of power, used only in emergencies or during maintenance when primary station service is not available.

Station service power is the responsibility of the Applicant. The station service requirements of the new facilities, including voltage and reactive requirements, shall not impose operating restrictions on the HUC Transmission System beyond those specified in applicable NERC, MISO, and Applicable Regional Entity reliability standards.

Appropriate provisions for station service and alternate station service will be determined during the interconnection planning process. Generally, the local utility will be the provider of primary station service unless it is unable to serve the load.

The Applicant must provide metering for primary station service and alternate station service, as required by service provider, or work out other acceptable arrangements.

F. INSPECTION, TEST, CALIBRATION AND MAINTENANCE

The Applicant has full responsibility for the inspection, testing, calibration and maintenance of its equipment, up to the Point of Interconnection, consistent with the Interconnection and Operating Agreement.

1. Pre-energization Inspection and Testing

Before initial energization, the Applicant shall develop an Inspection and Test Plan for pre-energization and energization testing. HUC will review and approve the test plan prior to the test. Any costs incurred by HUC as a result of the inspection and testing will

be passed through to the Applicant. The Applicant will also be responsible for any additional tests that may be required by HUC but were not specified in the Applicant's Inspection and Test Plan. The Applicant shall provide HUC with copies of all drawings, specifications, and test records of the interconnection equipment and pertinent to the interconnected operation for HUC's records.

2. Calibration and Maintenance

a. Metering Equipment

Upon installation of, and at Applicant's expense, HUC shall inspect and test all Metering Equipment required by HUC. Thereafter, the meter testing frequency shall, at a minimum, be based on industry accepted practices and guidelines outlined in ANSI C12.1. HUC's present testing practices are based on the type of metering situation and the jointly agreed-to requirements of both parties involved. Typically, the metering equipment at non-HUC interconnection sites is tested every year. If requested to do so by Applicant, HUC shall inspect or test Metering Equipment more frequently than every year, at the expense of the Applicant. Any current or potential transformers that are used for metering will adhere to the "Accuracy Classifications for Metering" listed in ANSI C57.13. HUC requires a minimum of 0.3B accuracy class rating across the full expected operating range of the instrument transformer.

b. All Other Electrical Equipment

The Applicant shall maintain its facilities and equipment, to the extent they might reasonably be expected to have an impact on the operation of the HUC Transmission System and HUC's other systems: (1) in a safe and reliable manner; (2) in accordance with Good Utility Practice; (3) in accordance with operational and/or reliability criteria, protocols, and directives, including those of NERC, MISO, Applicable Regional Entity, or any successor agency assuming or charged with similar responsibilities; and (4) in accordance with the provisions of the Interconnection and Operating Agreement and any attachment, appendix or exhibit thereof.

G. METERING – OTHER

If a generator is added in addition to the load serving interconnection, the metering must be designed such that load can be identified separately from the net generator output. Such net output is the kWh output of the generator less the generation station auxiliary load. See "Hutchinson Utilities Commission Generation Interconnection Guidelines".

Modifications to the revenue metering are sometimes required. In general, the metering equipment will be modified to measure both delivered and received energy (both Watts & VARs). This can be accomplished by adding additional watt-hour and VAr-hour meters equipped with detents, or a multi-function bi-directional meter. Either installation will allow proper measurement of both real and reactive energy in both directions. The metering installation shall be electrically connected on the line side of the main generator disconnect thus allowing the meter to be read even when the generator is not running. For substation metering, the meter may be located on the low side of the step-down transformer, but the meter must be able to compensate for transformer energy losses from the high side of the transformer.

H. TELEMETRY

The requirements for telemetry are based on the need of the System Control Center to protect all users of the transmission and distribution system from unacceptable disturbances. The need for requiring telemetry may include the ability to monitor the following conditions:

- Detecting Facility backfeed onto otherwise de-energized lines
- Providing information necessary for reliable operation of HUC equipment feeders, substation, etc.) during normal and emergency operation
- Providing information necessary for the reliable dispatch of generation

Telemetry is required by HUC when:

- There is the potential for backfeeding onto the HUC System or islanding a portion of HUC's System.
- The Facility plans to provide its own ancillary services.
- There is intent to sell power and energy over HUC facilities.
- The Facility is required to meet the manual or automatic load shed requirement.
- 41.6 kV or 69 kV substations equipped with circuit breakers, or circuit switchers, and for all substations classified at 115 kV and above.
- FERC requires telemetering for normally open or emergency tie connections.

If "islanding" is a possibility, it will be identified during the interconnection study process. In such instances, the following telemetry may be required:

- Voltage representative of the HUC service to the Facility
- Status (open/close) of Facility and interconnection breaker(s)
- Position of incoming and tie breakers or switches
- Applicant load from HUC service (kW and kVAr)

When telemetry is required, the Applicant must provide the communications medium to HUC. RTU additions must be coordinated with HUC if a telephone circuit is used. The Applicant must also provide the telephone circuit protection. High capacity interconnections may require redundant metering and telemetering.

I. SUPERVISORY CONTROL AND DATA ACQUISITION (SCADA) REQUIREMENTS

SCADA indication of real and reactive power flows and voltage levels is required. If the connection is made directly to another utility's transmission system, SCADA control and status indication requirements shall be jointly determined. SCADA control and status indication of the circuit breakers and associated isolating switches used to connect with HUC may be required. SCADA control of breakers and isolating switches that are located at other than the Point of Interconnection is not normally required, although status indication may be necessary.

All substations with a high side circuit breaker shall provide status indication for the circuit breaker to the Balancing Authority Area Operator. The following equipment data and statuses must be provided in a 6 second or less periodicity to the Balancing Authority Area Operator:

- Breaker position
- Motor operated disconnect position
- Transmission line flow and alarming
- Bus voltage and associated equipment status
- Protective relaying AC and DC voltage status
- Protective relay communication channel status
- Transformer and associated equipment status
- Lockout relay status
- Capacitor/reactor status
- Other points as necessary to provide control and indication

J. ENERGIZATION OF HUC EQUIPMENT BY THE APPLICANT

No Applicants, independent of interconnection type or generator size, shall energize a de-energized HUC circuit. The necessary control devices shall be installed by the Applicant on the equipment to prevent the energization of a de-energized HUC circuit by the Applicant's interconnected Facility. Connection may be accomplished only via synchronization with the HUC System. All interconnecting circuit breakers/devices that tie another source to HUC will require synchro-check relaying. Authorization to energize a circuit may only be provided by the Balancing Authority Area Operator.

IV. SUBSTATION GROUNDING

Each Interconnecting Substation must have a ground grid that solidly grounds all metallic structures and other metallic equipment. This grid shall limit the ground potential gradients to such voltage and current levels that will not endanger the safety of people or damage equipment which are in, or immediately adjacent to, the station under normal and fault conditions. The size, type and ground grid requirements are in part based on local soil conditions and available electrical fault current magnitudes. In areas where ground grid voltage rises are not within acceptable and safe limits (due for example to high soil resistivity or limited substation space), grounding rods and wells can be used to reduce the ground grid resistance to acceptable levels.

If the Substation Site is close to another substation, the two ground grids may be isolated or connected. If the ground grids are to be isolated, it is suggested that metallic ground connections between the two substation ground grids be separated by at least 10 feet. Cable shields, cable sheaths, station service ground sheaths, and overhead transmission shield wires can all inadvertently connect ground grids. Fiber-optic cables are an excellent choice for telecommunications and control between two substations to maintain isolated ground grids.

If the ground grids are to be interconnected, the interconnecting cables must have sufficient capacity to handle fault currents and control ground grid voltage rises. HUC must approve any connection to an HUC substation ground grid.

The interconnection of lines and/or generation may substantially increase fault current levels at nearby substations. Modifications to the ground grids of existing substations may be necessary to keep grid voltage rises within safe levels. The Interconnection Study will determine if modifications are required and the estimated cost. The Reference section of this document supplies a list of ANSI/IEEE technical resources for grounding.

V. INTERCONNECTION FACILITY OPERATING LIMITS

Operating criteria have been defined for Applicant Facilities interconnecting with the HUC System in order to minimize the impact that adverse operating conditions could have on the electric service provided to other customers on the HUC System. The interconnection technical requirements are outlined in this section and where applicable, requirements specific to size and/or type of interconnection are noted.

A. VOLTAGE

The Applicant's equipment shall not cause excessive voltage excursions. The Applicant shall provide an automatic means of disconnecting its equipment from the HUC System within three seconds if the steady state voltage cannot be maintained within the required tolerance.

Portions of HUC's system at 13.8 kV and below is voltage regulated. When the interconnection is with a portion of the HUC delivery system that is regulated, then the Applicant shall be capable of tolerating steady-state voltage fluctuations of ± 5 percent of the nominal voltage level.

Transmission doesn't include a provision for voltage regulation. For interconnections to the transmission system, voltage levels ± 10 percent from nominal can be expected. If the Applicant's equipment cannot operate within the above range, the Applicant may need to provide regulation equipment to limit voltage level excursions.

If the design of the Applicant's Facility is such that islanded conditions are possible, appropriate zero sequence sources must also be provided. The usual customer voltage concern refers to line-line values, but generation installed on distribution lines must also control the line-ground voltage during an islanded condition.

Consistent with the Applicable Regional Entity's system performance criteria and technical study guidelines, the HUC System is designed to avoid experiencing dynamic voltage dips below .70 pu due to external faults or other disturbance initiators. The Applicant should allow sufficient dead band in its voltage regulation equipment control to avoid reacting to dynamic voltage dips.

B. FLICKER

Voltage fluctuations may be noticeable as visual lighting variations (flicker) and can damage or disrupt the operation of electronic equipment. In the case where the Applicant owns a dedicated line so that HUC's other customers will be protected, a waiver may be permitted.

Applicants are not allowed to produce flicker nor introduce excessive distortion to the sinusoidal voltage or current waves as defined by ANSI Standard C84-1-1989, in accordance with IEEE Standard 519, or any applicable superseding electric industry standard. The Applicant will be responsible and liable for corrections if the interconnecting Facility is the cause of objectionable flicker levels.

C. HARMONICS

Harmonics can cause telecommunication interference, increase thermal heating in transformers, disable solid state equipment and create resonant overvoltages. In order to protect equipment from damage, harmonics must be managed and mitigated. The Applicant's interconnecting equipment shall not introduce excessive distortion to the HUC System's voltage and current waveforms per IEEE 519-1992.

The harmonic distortion is defined as the ratio of the root mean square (rms) value of the harmonic to the rms value of the fundamental voltage or current. The harmonic distortion measurements shall be made at the point of interconnection between the Applicant and the HUC System and shall be within the limits specified in the tables below. HUC advises the Applicant to account for harmonics during the early planning and design stages. Refer to Tables 1 and 2 for voltage distortion limits.

Table 1. Voltage Distortion Limits

Bus Voltage at PCC	Individual Voltage Distortion IHD %	Total Voltage Distortion THD %
Below 69 kV	3.0	5.0
69 kV to 115 kV	1.5	2.5
115 kV and above	1.0	1.5
Source: IEEE 519, Table 11.1		

Table 2. Current Distortion Limits For Non-Linear Loads At The Point Of Common Coupling (PCC) From 120 to 69,000 Volts

Maximum Harmonic Current Distribution in % of Fundamental Harmonic Order (Odd Hermonics)						
I(sc)/I(l)	<11	11<h<17	17<h<23	23<h<35	35<h	THD
20	4.0	2.0	1.5	0.6	0.3	5.0
20-50	7.0	3.5	2.5	1.0	0.5	8.0
50-100	10.0	4.5	4.0	1.5	0.7	12.0
100-1000	12.0	5.5	5.0	2.0	1.0	15.0
1000	15.0	7.0	6.0	2.5	1.4	20.0
Where: I(sc) = Maximum short circuit current at PCC I(l) = Maximum load current (fundamental frequency) at PCC PCC = Point of Common Coupling between Applicant and utility						

Generation equipment is subject of the lowest $I(sc)/I(l)$ values
Even harmonics are limited to 25% of odd harmonic limits given above

Source: IEEE 519, Table 10.3

A special study will be required for situations when the fault to load ratio is less than 10. Lower order harmonics, particularly the third and ninth harmonics, will often be of more concern to the owner of generator. These are often related to generator grounding, and to the type of transformer connections that may be involved. It is to the Applicant's advantage to work these problems out early enough so that Applicant and HUC equipment can be acquired to achieve proper control.

D. FAULT CURRENT

The combined available fault current of the HUC System and the Applicant's facilities must not overstress HUC equipment. The Applicant shall provide any necessary provisions to satisfy this requirement.

If the installation of Applicant-owned equipment causes fault current limits to be exceeded, the Applicant must install equipment to limit the fault current on the HUC delivery system or compensate HUC for the additional costs of installing equipment that will safely operate within the available fault current. The exact value of available fault depends upon location and circuit configuration and will be determined in the interconnection studies. The Applicant must work closely with HUC at the time of interconnection design to determine the available fault current at the specific location of interconnection.

E. MINIMUM POWER FACTOR REQUIREMENTS

Substation - Specific Power Factor Requirements

The interconnecting entity will generally be expected to provide for its own as well as its customers' reactive power requirements.

Points of Interconnection (POI), transformer additions, and planned transformer capacity upgrades are expected to provide sufficient reactive power (leading or lagging) such that the power factor (PF) is between 98% lagging or leading at the POI when POI load is greater than 85% of maximum load. POI, transformer additions, and planned transformer capacity upgrades are expected have a PF that is not leading when the load is less than 50% of maximum load. As practical, the interconnecting entity will maintain a power factor between 98% lagging or leading at the POI when the load is between 50-85% of maximum. With mutual agreement of all affected parties, reactive power support may be considered for installation at an adjacent substation provided that the substation is in electrically close proximity. (An example is when a nearby substation has adequate support for the whole circuit.)

The interconnected entity is responsible for keeping their equipment in good working order so that PF requirements are always met.

If during normal operation (system intact or under transmission contingency conditions) the voltage in a portion of the transmission system deviates from the range described in Section V. Part A, HUC will survey the interconnected substations which, in its opinion, may contribute to the voltage concern and require the interconnected entity to demonstrate, either by transmission-side metering or low-side metering corrected for transformer reactive power consumption, that the interconnected entity meets the intended level of PF correction. Compliance in meeting the PF requirement will reasonably exclude time periods of the interconnected entity's emergency conditions, during the interconnected entity's switching operations, and periods when transformer loading and required PF correction would result in transformer resonance conditions. Any unacceptable deviations are to be corrected in a timely manner.

Transmission Facilities

Each Party recognizes and agrees that it has a responsibility for maintaining voltage and VAR support at POI in accordance with applicable Midwest ISO protocols and policies. HUC is responsible for maintaining Transmission System voltage and VAR flows on its system. Transmission facility owners are responsible for controlling Transmission System voltage and VAR flows on their respective systems. Each Party shall use a combination of static and dynamic reactive sources at various locations to address reactive power supply issues. Each Party shall operate its system in such manner that the voltage levels on the system are maintained at reliable levels.

F. FREQUENCY DURING DISTURBANCES

Power system disturbances initiated by system events such as faults and forced equipment outages expose the system to oscillations in voltage and frequency. It is important that generators and lines remain in service for dynamic (transient) oscillations that are stable and damped.

To avoid large-scale blackouts that can result from excessive generation loss, major transmission loss, or load loss during a disturbance, underfrequency load shedding has been implemented by the Applicable Regional Entity. When system frequency declines, loads are automatically interrupted in steps occurring at 59.3, 59.0, and 58.7 Hz, respectively. Load shedding attempts to stabilize the system by balancing the generation and load.

VI. PROTECTION REQUIREMENTS FOR ALL INTERCONNECTIONS

An important objective in the interconnection of facilities to HUC's system is minimizing the potential hazard to life and property. A primary safety requirement is the ability to disconnect immediately when a fault is detected. The protection equipment for an interconnected facility must protect against faults within that facility and faults on the HUC system. No new facility on the HUC System should degrade the existing HUC protection and control schemes or lower the levels of safety and reliability to other customers.

HUC's minimum protection requirements are designed and intended to protect HUC's system only. As a rule, neither party should depend on the other for the protection of its own equipment. HUC shall assume no liability for damage to Applicant-owned Facilities resulting from miscoordination between the Applicant's protective device(s) and HUC's protective devices. It is

the Applicant's responsibility to protect its own system and equipment.

Several factors may determine what protective devices are required on the Applicant's interconnection. The following three major factors generally determine the type of protective devices required at the Point of Interconnection:

- The type and size of the Applicant's interconnecting equipment.
- The location of the Applicant on the HUC System.
- The manner in which the installation will operate (one-way vs. two-way power flow).

The addition of the Applicant's Facility may also require modifying the HUC System or other interconnected facilities. This determination will be made by HUC during the preliminary portion of the interconnection study process. Each interconnection request will be handled individually and HUC will solely determine the protective devices, system modifications, and/or additions required. HUC will work with the Applicant to achieve an installation that meets the requirements of both the Applicant and HUC. The Applicant shall bear all costs for protective devices and HUC System modifications required to permit the operation of the parallel interconnection.

HUC shall operate all HUC-owned protective equipment at the interconnection to ensure that the protection and control requirements and objectives are met. During interconnection studies, HUC will approve the proposed type of interconnection protective devices, ownership, operating details and equipment settings. **Do not confuse interconnection protection in this section with Applicant-provided Facility protection. HUC is not liable or responsible for protection of the Applicant's facilities.**

A. DISCONNECT SWITCHES/DEVICE

A disconnect device should be installed to isolate the HUC System from the Applicant's Facility. This device must have load break capability or means must be provided to trip off generation or load before operating the disconnect. This disconnect shall open all the poles except the neutral and shall provide a visible air gap to establish required clearances for maintenance and repair work of the HUC system. A breaker that can be racked out into a visibly open position is also acceptable. HUC may require the design to allow the application of safety grounds on the HUC side of the disconnect (or breaker). OSHA lockout/tag requirements must be followed.

The disconnect (or breaker) must be accessible at all times to HUC personnel. Disconnects should allow for padlocking in the open position with standard HUC padlock. The Applicant shall not remove any padlocks or HUC safety tags. The disconnect (or breaker) should be located outside of the building if possible. If not possible, Applicant must provide access to disconnect (or breaker) at all times (24 hour day phone number, guard desk, etc.) The disconnecting equipment must be clearly labeled. The disconnecting equipment shall be National Electrical Manufacturers Association (NEMA) approved for the specific application and location.

B. PROTECTIVE RELAY REQUIREMENTS

Protective relays are required to promptly sense abnormal operating or fault conditions and initiate the isolation of the faulted area. Protective relays can generally be categorized into two major groups: industrial grade and utility grade. Utility grade relays have a higher degree of reliability and accuracy and are required. Protective relay settings on interconnect breakpoints must be approved by HUC.

HUC requires line-protective equipment to either 1) automatically clear a fault and restore power, or 2) rapidly isolate only the faulted section so that the minimum number of customers is affected by any outage. Fault-interrupting equipment should usually be located at the point of interconnection to HUC or as close to the interconnection point as practicable. High speed fault clearing may be required to minimize equipment damage and potential impact to system stability. The need for high speed fault clearing shall be determined on a case-by-case basis by HUC.

The Applicant shall install only HUC approved relays on the part of their system that can impact the operation of the HUC System. These relays must, at a minimum, meet IEEE Standards C37.90, C37.90.1, and C37.90.2. Applicants shall submit complete control and relaying documentation that pertains to protection of the HUC System. HUC may suggest or comment on other areas; however, the Applicant is responsible for the design of protection schemes protecting Applicant facilities.

Table 3 provides protective device recommendations necessary to protect HUC equipment and its customers' equipment against electrical faults (short circuits), degraded voltage or frequency operation, unwanted power flow and inadvertent out of phase closing of breaker/switches. Some protective devices may or may not be required for Applicants as determined by HUC on a case-by-case basis. Most line relaying depends on the existing system configuration, the existing protection, and line characteristics such as impedance, voltage, ampacity and available fault duty, at the location in question. Generator protection may depend upon the size of the generator, location and nature of interconnection and coordination requirements with HUC protective systems. All necessary protective requirements will be identified during the interconnection study process.

Table 3. Basic Line Protection Devices (Protection must be redundant at 69 kV and above for all applications. For lower voltage systems redundancy is only required for some specific areas of the system. Pilot relaying is required at 115kV and above for all applications.)

Protection Device	Device Number	Less than 41.6 kV	41.6 kV to 69 kV	115 kV	230 kV
Phase Overcurrent (Radial systems)	50/51	X	X		
Ground Overcurrent (Radial systems)	50/51N	X	X		
Phase Directional Overcurrent	67	X ¹	X	X	
Ground Directional Overcurrent or Transformer Neutral	67N 50/51N	X ¹	X	X	X
Distance Relay Zone 1	21Z1		X	X	X
Distance Relay Zone 2	21Z2		X	X	X
Distance Relay Carrier	21Z2C			X	X
Ground Directional Overcurrent Carrier	67NC			X	X
Distance Relay Carrier Block	21Z3C			X	X
Pilot Wire	87L			X	X
Permissive Overreaching Transfer Trip (POTT) or Hybrid	21/67T			X	X
Power Fail Trip ³	27		X ¹	X	X

Direct Transfer Trip	TT	X ²	X	X
----------------------	----	----------------	---	---

¹ May be required depending on local circuit configurations

² Transfer trip may be required on interconnections depending on HUC circuit configuration and loading, as determined by HUC. Typically, transfer trip is required on multi-terminal lines.

³ Power failure tripping may be required on load tie-line interconnections to facilitate restoration of customer load after transmitting line or area outage.

C. RELIABILITY AND REDUNDANCY

The failure to trip during fault or abnormal system conditions due to relay or breaker hardware problems, or from incorrect relay settings, improper control wiring, etc. is always a possibility. The protection system must be designed with enough redundancy that failure of any one component still allows the Facility to be isolated from the HUC system under a fault condition. HUC may suggest or require back-up protection. If the Facility's breaker does not trip, the incoming breaker should trip after a predetermined time delay. Similarly, if the incoming breaker fails to trip, the Facility's breaker should trip. Where there is no incoming breaker, the HUC tie breaker may be tripped.

D. LINE PROTECTION

Applicants line-protection and/or facility relays must coordinate with the protective relays at the HUC breakers for the line on which the Applicant's Facility is connected. The typical protective zone is a two-terminal line section with a breaker on each end. In the simplest case of a load on a radial line, current can flow in one direction only, so protective relays need to be coordinated in one direction and do not need directional elements. However, on the typical transmission system, where current may flow in either direction depending on system conditions, relays must be directional. In addition, the complexity and the required number of protective devices increase dramatically with increases in the number of terminals in each protective zone. Because of this complexity, HUC does not permit lines with greater than three terminals.

In coordinating a multi-terminal scheme, HUC may sometimes require installation of a transmission line protective relay at the Applicant's substation site. This is commonly the case whenever three-terminal permissive overreach transfer trip (POTT) schemes or blocking schemes are employed to protect the line. Because this type of line relay participates in a scheme to protect the HUC transmission system, HUC must ensure the maintenance, testing and reliability of this particular type of relay. Existing relay schemes may have to be reset, replaced, or augmented with additional relays at the Applicant's expense, to coordinate with the Applicant's Facility.

If transfer trip protection is required by HUC, the Applicant shall provide, and maintain at its expense a communications circuit, and must have an end to end signal relay of no more than 8 milliseconds. This circuit may be a communication line from the telephone company or a dedicated cable. In certain cases power line carrier, fiber optic cable, or microwave communication circuits are also acceptable. The line must have high-voltage protection equipment on the entrance cable so the transfer trip equipment will operate properly during fault conditions.

The addition of any new interconnected facility to the HUC system must not degrade the existing protection and control schemes or cause existing HUC customers to suffer lower

levels of safety and/or reliability.

Table 3 lists the minimum protection that HUC typically requires. Higher voltage interconnections require additional protection due to the greater potential for adverse impact to system stability and the greater number of customers who would be affected. Special cases such as distribution-level network interconnections, if acceptable, may have additional requirements. The acceptability and additional requirements of these interconnection proposals shall be determined by HUC on a case-by-case basis.

E. FAULT-INTERRUPTING DEVICES

The fault-interrupting device selected by the Applicant must be reviewed and approved by HUC for each particular application.

There are three basic types of fault-interrupting devices:

- Circuit Breakers
- Circuit Switchers
- Fuses

HUC will determine the type of fault-interrupting device required for a facility based on the available fault duty, the local circuit configuration, the size and type of generation, and the existing HUC protection equipment.

1. Circuit Breakers

Ownership of the intertie circuit breaker will be determined during the interconnection study. However, HUC will have the operational authority to operate all intertie circuit breakers at all substation or tie-line interconnections installations. Upgrading existing circuit breakers within or outside the area of the interconnection may be required due to the increased fault current levels. If this system modification is necessary, it may be at the Applicant's expense.

A three-phase circuit breaker at the point of interconnection automatically separates the Applicant's Facility from the HUC system upon detection of a circuit fault. Additional breakers and protective relays may be installed in the Applicant's Facility for ease in operating and protecting the Facility, but they are not required for the purpose of interconnection. The interconnection breaker must have sufficient capacity to interrupt maximum available fault current at its location and be equipped with accessories to:

- Trip the breaker with an external trip signal supplied through a battery (shunt trip).
- Telemeter the breaker status when it is required.
- Lockout if operated by protective relays required for interconnection.

Generally, a three-phase circuit breaker is the required fault-interruption device at the point of interconnection, due to its simultaneous three-phase operation and ability to coordinate with HUC line-side devices.

2. Circuit Switchers

A circuit switcher is a three-phase fault-interrupter with limited fault interrupting capability. These devices have typically been used at voltages of 115 kV and below and may substitute for circuit breakers when the fault duty is within the interrupting rating of the circuit switcher. Since circuit switchers do not have integral current transformers, they must be installed within 30 feet of the associated current transformers to minimize the length of the unprotected line/bus section.

3. Fuses

Fuses are single-phase, direct-acting sacrificial links that melt to interrupt fault current and protect the equipment. Blown fuses need to be replaced manually after each fault before the Facility can return to service. Overhead primary fuses shall be replaced by trained, qualified personnel. Because fuses are single-phase devices, all of them may not melt during a fault and therefore would not automatically separate the interconnected Facility from HUC. Large primary fuses which do not coordinate with the HUC substation breaker ground relays could cause all the customers on the circuit to lose power due to a fault inside the Applicant's interconnected Facility and therefore will not be allowed.

For load-only facilities, HUC may approve the use of fuses if they coordinate with the HUC line-side devices for both phase and ground faults. In these cases HUC requires time current curves. In limited cases, fuses may be used as a primary protective device (e.g. rural, 60 kV, 70 kV and 115 kV lines, generally when the Applicant's substation is 10 MW or less). However, if fuses are approved by HUC, the Applicant should consider installing a negative sequence relay and/or other devices to alarm for single-phase conditions.

For generation interconnections, fuses cannot be operated by the protective relays and therefore cannot be used as the primary protection for three-phase generation facilities. Fuses may be used for high-side transformer protection for generation less than 5 MW, provided coordination can be obtained with the existing HUC phase and ground protection and if a separate generator breaker provides the required primary protection. Fuses are not permitted for high-side transformer protection for facilities of 5 MW or greater.

F. SINGLE-PHASE DEVICES - FUSES/OIL CIRCUIT RECLOSERS

It may be necessary to replace HUC-owned single-phase devices (line fuses, single-phase automatic circuit reclosers) with three-phase devices when they are installed between the HUC source substation with breakers and the Applicant substation or tie-line. This is to minimize the possibility of single-phasing an Applicant's three-phase load or tie. Single-phase sectionalizing equipment may be installed on the main circuit past the Applicant location, or on radial circuits that tap the main circuit between the source substation and the Applicant location.

Because the Applicant is responsible for protecting its equipment from the effects of excessive negative sequence currents, the Applicant must know if there are single-phase devices located between its Facility and the HUC source substation.

G. AUTOMATIC RECLOSING/VOLTAGE CHECK SCHEMES

HUC normally applies automatic reclosing to all transmission and overhead distribution lines. Prior to automatic reclosing, the Applicant must ensure that the Applicant's Facility is disconnected from HUC. It may be necessary to install voltage check schemes at various

locations on the HUC System to prevent automatic reclosing in the event that an Applicant's Facility remains connected to an isolated, unfaulted section of the HUC System. These voltage check schemes may be located at the interconnection point, at automatic circuit reclosers on the line feeding the Applicant, or on an HUC source substation feeder breaker. These schemes may also be required on alternate circuits that may be used to feed the Applicant. Details of any modifications to HUC reclosing practices and/or addition of voltage check schemes will be determined during the interconnection study process.

HUC shall assume no responsibility for damage to Applicant's equipment due to out-of-phase reclosing.

In general, reclosing practices should be as follows:

- There should be no automatic reclosing for the incoming breaker.
- The HUC substation breaker may have one or more timed recloses, with the first set at a minimum of .5 to 2 seconds at 69kV and below. It is expected that either the generator or the tie breaker will open before reclosing takes place. Reclosing times may be faster above 69kV.
- Where islanding is possible, the HUC substation breaker may need the function of voltage supervision from the tie-line.

H. INSULATION COORDINATION

Power system equipment is designed to withstand voltage stresses associated with expected operation. Adding or connecting new facilities can change equipment duty, and may require that equipment be replaced or switchgear, telecommunications, shielding, grounding and/or surge protection added to control voltage stress to acceptable levels. Interconnection studies may identify additional requirements to maintain an acceptable level of HUC System availability, reliability, equipment insulation margins, and safety.

Voltage stresses, such as lightning or switching surges, and temporary overvoltages may affect equipment function. Remedies depend on the equipment capability and the type and magnitude of the stress. In general, stations with equipment operated at 15 kV and above, as well as all transformers and reactors, shall be protected against lightning and switching surges. Typically, this includes station shielding against direct lightning strokes, surge arresters on all wound devices, and shielding with rod gaps (or arresters) on the incoming lines. The following requirements may be necessary to meet the intent of HUC's Reliability Criteria.

1. Surge Protection

The interconnection shall have the capability to withstand voltage and current surges in accordance with the environments defined in IEEE/ANSI C62.41 and IEEE C37.90.1.

HUC highly recommends the Applicant to install surge arresters for protection of transformers and other vulnerable equipment. Arresters shall be mounted in such a manner as to protect any of HUC's facilities from surge voltages. In general, all HUC incoming lines shall be protected with surge arresters located on the line side of the disconnect switch. HUC staff will recommend the appropriate level of entrance protection as well as other specifications for surge arresters during the interconnection the process.

2. Lightning Surges

If the Applicant proposes to tap a shielded transmission line, the tap line to the substation must also be shielded. For an unshielded transmission line, the tap line does not typically require shielding beyond that needed for substation entrance. However, special circumstances such as the length of the tap line may affect shielding requirements. Lines at voltages of 69 kV and higher that terminate at HUC substations must meet additional shielding and/or surge protection requirements. Incoming lines must be shielded for ½ mile at 69-150 kV and 1 mile at 230 kV and higher. Arrestors must also be installed at the station entrance. For certain customer service substations at 230 kV and below, HUC may require only an arrester at the station entrance in lieu of line shielding, or a reduced shielded zone adjacent to the station. These variations depend on the tap line length, the presence of a power circuit breaker on the transmission side of the transformer, and the size of the transformer. Such exceptions can be discussed with your HUC representative.

3. Temporary Overvoltages

Temporary overvoltages can last from seconds to minutes, and are not characterized as surges. These overvoltages are present during islanding, faults, loss of load, or long-line situations. All new and existing equipment must be capable of withstanding these duties.

a. Islanding

A 'local island' condition can expose equipment to higher-than-normal voltages. Special relays to detect this condition and isolate local generation from HUC facilities may be required.

b. Neutral Shifts

When generation or a source of 'back-feed' is connected to the low-voltage side of a delta-grounded wye customer service transformer, remote end breaker operations initiated by the detection of faults on the high-voltage side can cause overvoltages that can affect personnel safety and damage equipment. This type of overvoltage is commonly described as a neutral shift and can increase the voltage on the unfaulted phases to as high as 1.73 per unit. At this voltage, the equipment insulation withstand-duration can be very short. Several alternative remedies are possible:

- Provide an effectively grounded system on the high-voltage side of the transformer that is independent of other transmission system connections.
- Size the high-voltage-side equipment to withstand the amplitude and duration of the neutral shift.
- Rapidly separate the back-feed source from the step-up transformer by tripping a breaker using either remote relay detection with pilot scheme (transfer trip) or local relay detection of overvoltage condition.

Effectively grounded is defined as an $X_0/X_1 \leq 3$ and $R_0/X_1 \leq 1$. Methods available to obtain an effective ground on the high-voltage side of the transformer include:

- A transformer with the transmission voltage (HUC's) side connected in a grounded-wye configuration and low voltage (Connection Point) side in closed delta.

- A three-winding transformer with a closed-delta tertiary winding. Both the transmission and distribution side windings are connected in grounded wye.
- Installation of a grounding transformer on the transmission voltage (HUC) side.

Any of these result in an effectively grounded system with little risk of damage to surge arresters and other connected equipment.

I. MAINTENANCE OF APPLICANT-OWNED INTERCONNECTION PROTECTIVE DEVICES

Interconnection protective devices owned by the Applicant (as determined by the interconnection study process) should be maintained and inspected according to manufacturer recommendations and/or industry standards. Procedures must be established for visual and operational inspections. Additionally, provisions should be established for equipment maintenance and testing. Equipment should include, but not be limited to:

- Circuit Breakers
- Protective Relays
- Control Batteries
- PTs, CT's, Fuses, Switches, SCADA Equipment
- Metering

MISO requires that all Transmission/Substation facilities shall have a documented maintenance and testing plan. Applicant shall establish and perform this plan per current MISO requirements.

HUC maintains the right to review maintenance, calibration and operation data of all protective equipment for the purpose of protecting HUC facilities and other HUC customers. The Applicant is responsible for providing the necessary test accessories (such as relay test plugs, instruction manuals, wiring diagrams, etc.) required to allow HUC to test these protective devices. Verification may include the tripping of the intertie breaker.

If HUC performs work on the Applicant's premises, an inspection of the work area may be made by HUC operating personnel. If hazardous working conditions are detected, the Applicant will be required to correct the unsafe conditions before HUC will perform the work.

J. COMMUNICATION CIRCUIT

HUC may require that a communication circuit and associated communication equipment be installed as part of the protective scheme. This circuit may consist of power line carrier, leased telephone line, pilot wire circuit, fiber optic cable, radio, or other means. The communication circuit is required in cases where it is necessary to remotely send a signal to remove the Applicant's Facility from the HUC System due to a fault or other abnormal conditions that cannot be sensed by the protective devices at the Applicant's location. Some instances may require installation of communication equipment in HUC substations to initiate the protective signals. HUC shall be reimbursed by the Applicant for the cost of this equipment and its installation.

Another communication circuit may be needed for monitoring and control purposes. Telemetry requirements are defined in Section III.H. Specific communication circuit requirements

will be determined during the interconnection study process. The cost of installation and additional monthly fees for this circuit will be the responsibility of the Applicant.

VII. OPERATING GUIDELINES

The Applicant shall operate its equipment within the guidelines of this document and any special requirements set forth by executed agreements. Where there is conflict or inconsistency with the terms of the agreement(s) and this document, the terms in the agreement(s) shall apply. HUC reserves the right to open the intertie circuit breaker or disconnect device for any of the following reasons:

- HUC is performing hot line maintenance work on the HUC System.
- HUC System Emergency.
- Inspection of the Applicant's equipment and protective equipment reveals a hazardous condition.
- Failure of the Applicant to provide maintenance and testing reports when required.
- The Applicant's equipment interferes with other customers or with the operation of the HUC's system.
- The Applicant has modified the equipment or protective devices without the knowledge or approval of HUC.
- Operation, by Applicant, of any unapproved interconnected equipment.
- Personnel safety is threatened.
- Failure of the Applicant to comply with applicable OSHA Safety Tagging and Lockout requirements as well as MISO, Applicable Regional Entity, and HUC switching guides and safety standards or any successor agency assuming or charged with similar responsibilities.

The failure of HUC to open the intertie circuit breaker or disconnect device shall not serve to relieve the Applicant of any liability for impacts of non-metered power, injury, death or damage attributable to the negligence of the Applicant.

Changes to the HUC System, or the addition of other customers with generation in the vicinity, may require modifications to the interconnection protective devices. If such changes are required, the Applicant may be subject to future charges for these modifications.

VIII. GLOSSARY

Alternating Current (AC): That form of electric current that alternates or changes in magnitude and polarity (direction) in what is normally a regular pattern for a given time period called frequency.

Ampere (AMP): The unit of current flow of electricity. It is to electricity as the number of gallons per minute is to the flow of water. One ampere flow of current is equal to one coulomb per second flow.

Apparent Power: For single phase, the current in amperes multiplied by the volts equals the apparent power in volt-amperes. This term is used for alternating current circuits because the current flow is not always in phase with the voltage; hence, amperes multiplied by volts does not necessarily give the true power or watts. Apparent power for three-phase equals the phase to neutral volts multiplied by ampere multiplied by 3.

Applicable Regional Entity: The reliability region of NERC, or its successor, in which the Facility is located.

Automatic: Self-acting, operated by its own mechanism when actuated by some impersonal influence as, for example, a change in current strength; not manual; without personal intervention.

Automatic Reclosing: A circuit breaker has automatic reclosing when means are provided for closing without manual intervention after it has tripped under abnormal conditions.

Automatic Tripping (Automatic Opening; Automatic Disconnecting): The opening of a circuit breaker under predetermined conditions without the intervention of an operator.

Balanced Load: An equal distribution of current on all phases of an AC circuit.

Capacity: The number of amperes of electric current a wire will carry without becoming unduly heated; the capacity of a machine, apparatus or device, is the maximum of which it is capable under existing service conditions; the load for which a transformer, transmission circuit, apparatus, station or system is rated; for a generator, turbine, the URGE rating.

Circuit: A conducting path through which an electric current is intended to flow.

Circuit Breaker: A device for interrupting a circuit between separable contacts under normal or fault conditions.

Closed Momentary Parallel Transition: In this scheme, an Applicant's source of power is transferred from Source 1 to Source 2 and vice-versa by momentarily connecting the two sources together. The Applicant's load is not interrupted during the transfer process.

Closed Continuously Parallel Transition: In this scheme, an Applicant's source of power is

supplied from the utility grid and from the local generation source. The Applicant's load is not interrupted if the local generation source is not available.

Balancing Authority Area: A balancing authority area is an electrical system bound by interconnect (tie- line) metering and telemetry and regulating its generation in order to maintain its interchange schedule with other systems, contributes to frequency regulation of the Interconnection and fulfills its obligations and responsibilities in accordance with NERC and reliability region requirements.

Balancing Authority Area Load: A balancing authority area load is the entire demand for energy within a specified Balancing Authority Area.

Cogeneration: The concurrent production of electricity and heat, steam or useful work from the same fuel source.

Current: A flow of electric charge measured in amperes.

Current Transformer (CT): A transformer intended for metering, protective or control purposes, which is designed to have its primary winding connected in series with a circuit carrying the current to be measured or controlled. A current transformer normally steps down current values to safer levels. A CT secondary circuit must never be open-circuited while energized.

Delivered Energy: Energy sold to the Applicant from HUC.

Delta Connected Circuit: A three-phase circuit with three source windings connected in a closed delta (triangle). A closed delta is a connection in which each winding terminal is connected to the end (terminal) of another winding.

Demand: The rate at which electric power is delivered to or by a system; normally expressed in kilowatts, megawatts, or kilovolt-amperes.

Direct Current (DC): An electric current flowing in one direction only and substantially constant in value.

Disconnect: A device used to isolate a piece of equipment. A disconnect may be gang-operated (all poles switched simultaneously) or individually operated.

Dispatchable: Capable of having generator output (real and reactive power) adjusted ("dispatched") upon request of HUC power system operator. The adjustment includes capability to start-up and shut down generating units.

Energy Losses: The general term applied to energy lost in the operation of an electrical system. Losses can be classified as Transformation Losses, Transmission Line Losses or System Losses.

EMS: Energy Management System. The computer system HUC uses to provide real-time status and remote control of its electrical transmission system.

Facility: The Applicant's electric generating, tie-line, or substation facility identified generally in the Interconnection and Operating Agreement and more specifically identified in the "as built" drawings provided to the Company in accordance with Section 9.4 of the Interconnection and Operating Agreement, together with the other property, facilities, and equipment owned and/or

controlled by the Applicant on the Applicant's side of the Points of Interconnection.

FERC: Federal Energy Regulatory Commission. FERC is an independent body within the Department of Energy (DOE) regulating interstate transmission, prices of electricity and natural gas. It also licenses hydroelectric projects, interconnections, construction work in progress, rates for wholesale customers, and utility accounting practices and procedures.

Frequency: The number of cycles occurring in a given interval of time (usually one second) in an electric current. Frequency is commonly expressed in hertz.

Fuse: A short piece of conducting material of low melting point that is inserted in a circuit for the purpose of opening the circuit when the current reaches a certain value.

Ground: A term used in electrical work in referring to the earth as a conductor or as the zero of potential. For safety purposes, circuits are grounded while any work is being done on or near a circuit or piece of equipment in the circuit; this is usually called protective or safety grounding.

Hertz: The term denoting frequency, equivalent to cycles per second.

Incoming Breaker: The Applicant-owned breaker that connects HUC source of power to the Applicant's bus.

Interconnection: The physical system of electrical transmission between the Applicant's generation and the utility.

Interrupting Capacity: The amount of current a switch, fuse, or circuit breaker can safely interrupt.

Interruption: A temporary discontinuance of the supply of electric power.

Island: A part of an interconnected system that may be isolated during a system disturbance and start operating as a subsystem with its own generation, transmission and distribution capability. Then the subsystem becomes an island of the main interconnected system without a tie. In such a case, the islanded system and the main interconnected system will operate at different frequencies and voltages.

Isolated: In this scheme, the generating unit will supply all of the needs of the connected load.

Kilovolt (kV): One thousand volts.

Kilovolt-Ampere (kVA): One thousand volt amperes. See the definition for Apparent Power.

Kilowatt (kW): An electric unit of power that equals 1,000 watts.

Kilowatthour (kWh): One thousand watts of power supplied for one hour. A basic unit of electric energy equal to the use of 1 kilowatt for a period of one hour.

Lagging Power Factor: Occurs when reactive power flows in the same direction as real power.

Leading Power Factor: Occurs when reactive power flows in the opposite direction of real power.

Line Losses: Electrical energy converted to heat in the resistance of all transmission and/or distribution lines and other electrical equipment.

MISO: Mid-West Independent System Operator, or success organization.

NERC: North American Electric Reliability Corporation. A national organization responsible for establishing the reliability standards to assure the reliability of the electric grid, or successor organization.

OASIS: Open Access Same-time Information System - An Internet based system designed to allow all participants in the power market to obtain information concerning the capability and use of the transmission system in a non-discriminatory manner.

Ohm: The practical unit of electrical impedance equal to the resistance of a circuit in which a potential difference of 1 volt produces a current of 1 ampere.

One-Line Diagram: A diagram in which several conductors are represented by a single line and in which various devices or pieces of equipment are denoted by simplified symbols. The purpose of such a diagram is to present an electrical circuit or circuits in a simple way so that their function can be readily grasped.

Operating Reserve: The sum of Spinning and Non-Spinning Reserve.

Parallel Operation: The operation of an Applicant-owned generator while connected to the utility's grid. Parallel operation may be required solely for the Applicant's operating convenience or for the purpose of delivering power to the utility's grid.

Peak Load: The maximum electric load consumed or produced in a stated period of time.

Point of Energy Exchange: The point in the delivery system where one party takes delivery of the energy from the other party. This point is defined in the contract between HUC and the Applicant. It is often the point where facility ownership changes. This point may also be called the Point of Interchange when dealing with a bi-directional energy exchange or the Point of Delivery if the energy flows in one direction.

Point of Interconnection (POI): The point or points where the facilities of the Applicant interconnect with the facilities of HUC (point of ownership change). **Point of Metering:** The point where metering equipment (meters, transducers, current transformers, potential transformers, etc.) is or will be installed to measure the power flow and energy exchange between HUC and the Applicant.

Power: Actual, Active or Real Power. The time rate of transferring or transforming energy or the power that accomplishes work. Measured in Watts.

Power Factor (PF): The ratio of actual power (kW) to apparent power (kVA).

Power Flow: One-way power flow is the condition where the flow of power is entirely into the Applicant's Facility. Two-way power flow is the condition where the net flow of power may be either into or out of the Applicant's Facility depending on the operation of the generator and other customer load.

Protection: All of the relays and other equipment that are used to open the necessary circuit breakers to clear lines or equipment when trouble develops.

Reactive Power: (VAR) The power that oscillates back and forth between inductive and capacitive circuit elements without ever being used. The function of reactive power is to establish

and sustain the electric and magnetic fields required to perform useful work.

Received Energy: Energy received by HUC from the Applicant.

Reclose: To return a circuit breaker to its closed position after it has opened by relay action.

Relay: A device that is operative by a variation in the condition of one electric circuit to affect the operation of another device in the same or in another electric circuit.

Switch: A device for making, breaking or changing the connections in an electric circuit.

Synchronism: Expresses the condition across an open circuit wherein the voltage sine wave on one side matches the voltage sine wave on the other side in frequency and amplitude without phase angle difference.

System: The entire generating, transmitting and distributing facilities of an electric company.

System Control Center: Systems and System Operators used in the coordination and deployment activities required to support the safe and reliable operation of interconnected systems.

System Operator: A person authorized to operate or supervise the operation of the interconnected systems within the Balancing Authority Area.

Transformer: An electric device, without continuously moving parts, in which electromagnetic induction transforms electric energy from one or more other circuits at the same frequency, usually with changes of value of voltage and current.

Voltage: Electric potential or potential difference expressed in volts.

Volt-Ampere: A unit of apparent power in an alternating-current circuit.

VAr: Volt ampere reactive, see Reactive Power.

Watt-Hour: A unit of work or energy equivalent to the power of one watt operating for one hour.

Wheeling: The use of transmission facilities of one utility system to transmit power to another utility system, or between customer facilities within a single utility system or between systems.

Wye or "Y" Connected Circuit (Star Connected): A three-phase circuit in which windings of all three phases have one common connection.